


NOTE:

VALVE BOXES FOR WATER MAINS AND SERVICES SHALL BE AT LEAST 10'-0" FROM ALL STRUCTURES AND AT LEAST 2'-0" FROM ALL SHRUBS AND TREES.

WATER MAINS AND SERVICES SHALL HAVE A MINIMUM OF 10'-0" SEPARATION FROM ALL STRUCTURES INCLUDING VAULTS AND SEPTIC TANKS.

THE DISTRICT SHALL INSPECT ALL UNDERGROUND SERVICE INSTALLATIONS INCLUDING RENEWALS PRIOR TO BACKFILLING.

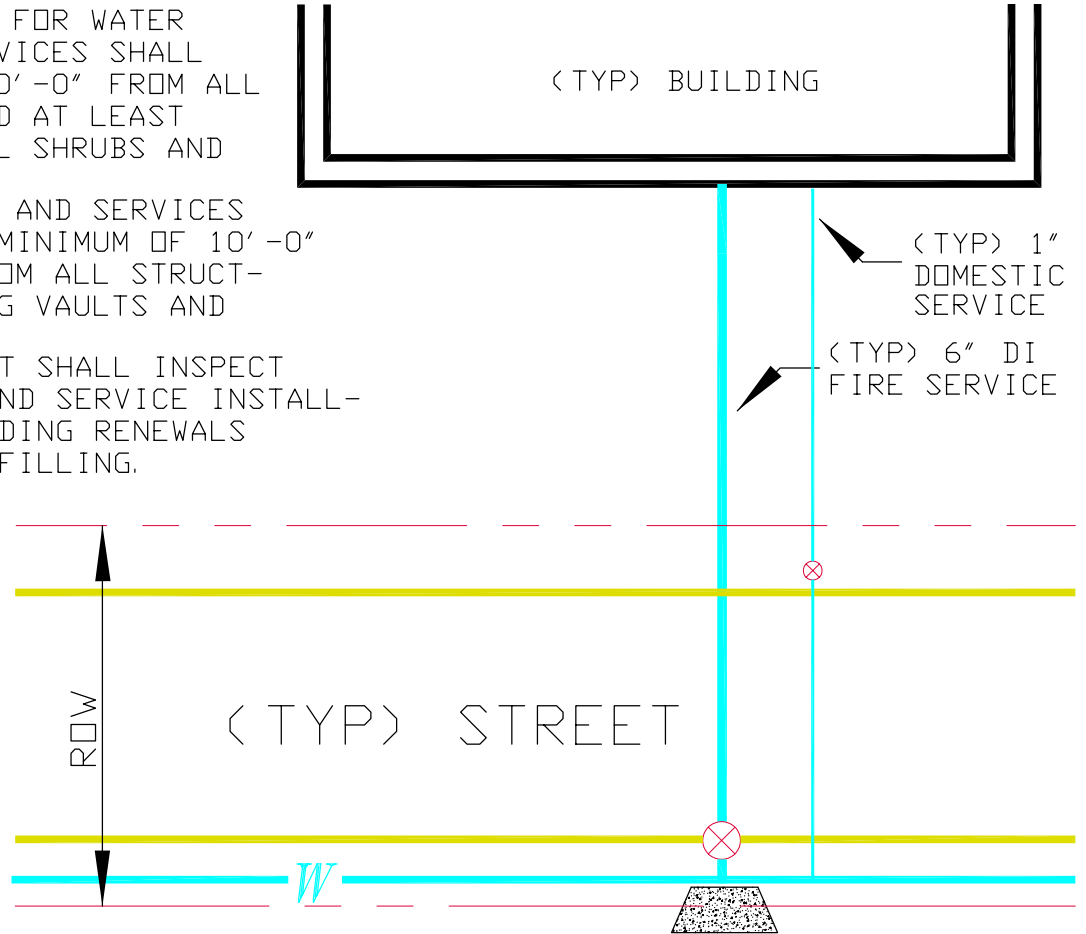

*TYPICAL DOMESTIC/FIRE SERVICE*

N. T. S.

