


OFFSETS RODDED TO-  
GETHER W/ REDI-ROD  
& DUC-LUGS


SEWER OR STORM  
DRAIN

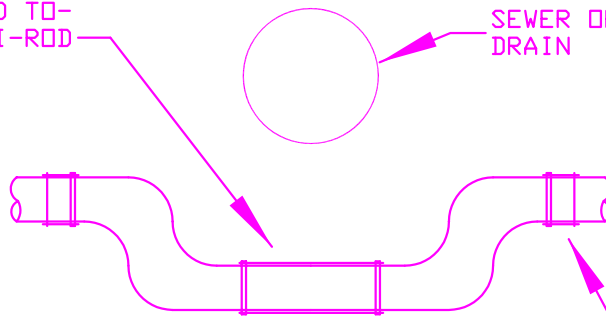

RETAINING GLANDS

45 BENDS TO BE  
RODDED TOGETHER  
W/ REDI-ROD &  
DUC-LUGS

SEWER OR STORM  
DRAIN

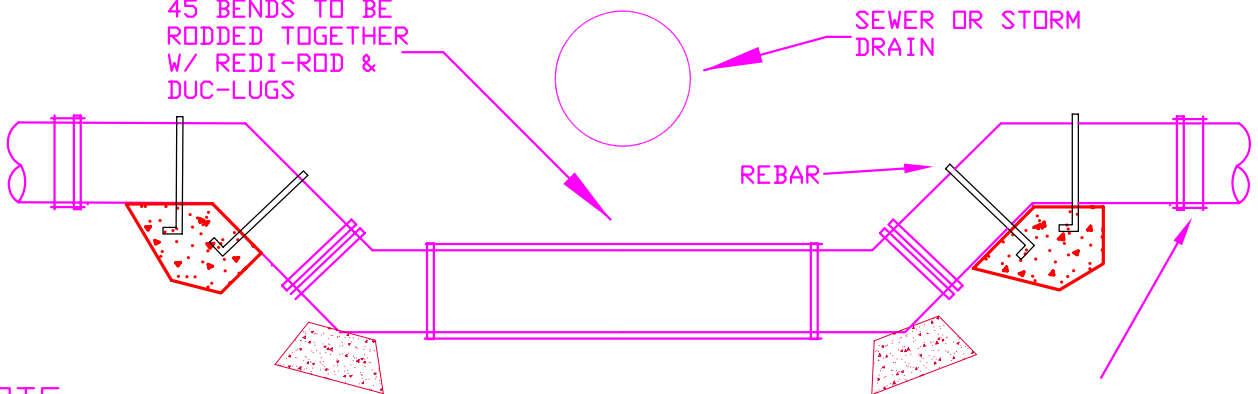

REBAR

RETAINING GLANDS

NOTE:

VERTICAL SEPARATION BETWEEN  
SEWER OR STORM DRAINS 18' MIN.  
HORIZONTAL SEPARATION BETWEEN  
SEWER OR STORM DRAINS 10'-0"  
MIN. ON MAINS AND 10'-0" SEPAR-  
ATION ON SERVICES. ANY EXCEPT-  
ION TO THE ABOVE MUST BE AUTH-  
ORIZED BY THE SEARSPORT WATER DIS-  
TRICT.

NOTE: REDI ROD REQUIREMENTS  
<12' = 2- 3/4"  
>12' = 3- 3/4"  
OR PER SWD DESIGN

# OFFSETS

N. T. S.

